



# SUBMITTAL INFORMATION

## Lead-Pak Coupling - (Q1Q1-33-Q3Q3-22 style)



### LEAD PIPE TO LEAD PIPE

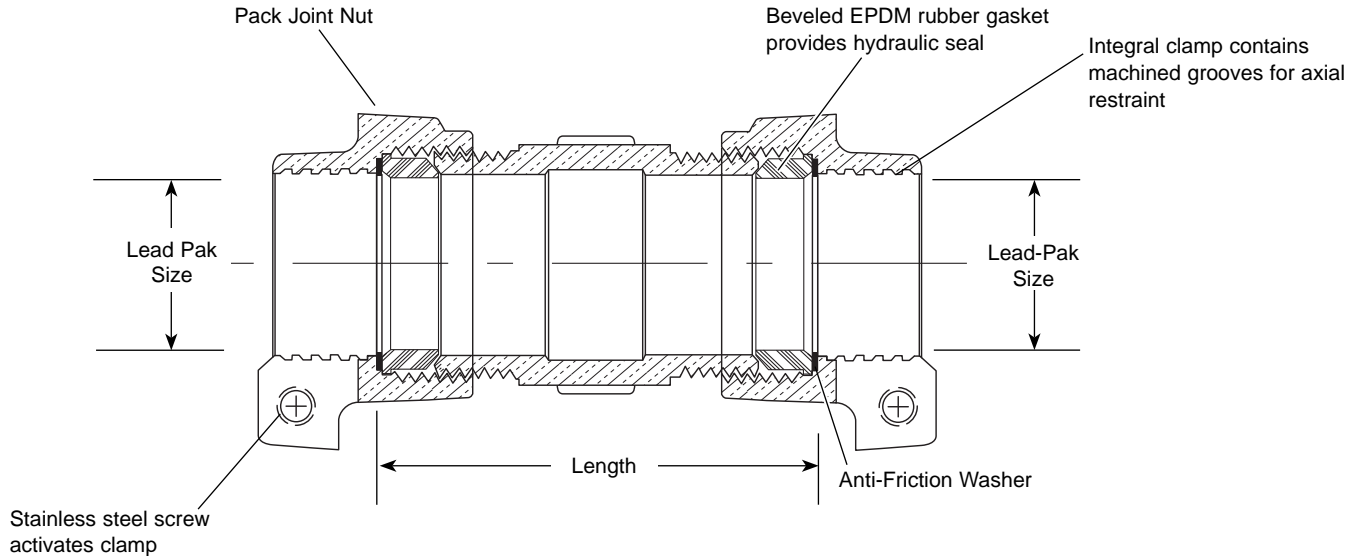

LEAD-PAK SIZE	LEAD-PAK SIZE	LENGTH	APPROX. Wt. LBS.	CATALOG NUMBER	✓ SUBMITTED ITEM(S)
5/8" dbl. extra strong lead (xxs) or 3/4" strong lead (s)	5/8" dbl. extra strong lead (xxs) or 3/4" strong lead (s)	2-1/8"	1.0	Q1Q1-33-Q3Q3-22	



### FEATURES

- All brass conforms to AWWA Standard C800 (ASTM B-62 and ASTM B-584, UNS NO C83600 - 85-5-5-5)
- To attach copper or plastic tubing (CTS) to an existing lead service line
- Sleeve design provides wrench lugs to facilitate installation
- Grip Joint couplings are not compatible with lead pipe

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current.



#### The Ford Meter Box Company, Inc.

P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443

Phone: 260-563-3171 / Fax: 800-826-3487

Overseas Fax: 260-563-0167

<http://www.fordmeterbox.com>

06/01/09

Submitted By: